



UNIVERSITY OF
TORONTO

Facilities & Services

Door hardware standard

Last updated: August 14, 2025

Revision 03

Table of contents

08 71 00 Door hardware.....	3
General.....	3
1. Keying.....	3
2. Closers	3
3. Door operators.....	4
4. Locksets	4
5. Exit devices	4
6. Hinges.....	4
7. Electric locking devices	5
8. Door pulls and kick plates	5
9. Door seals	6
10. Standard measurements.....	6
Appendix A	6

08 71 00 Door hardware

General

In the planning stage of a project, a determination shall be made regarding the need for or desirability of including a security access system in the building. If security access is to be integrated into the building, the designed system shall adhere to the schematic diagrams in Appendix A. The security system shall be reviewed with University of Toronto.

All low voltage wiring shall be stranded and shielded copper conductors installed in conduit or plenum rated in hollow metal door frame where accessible.

To ensure barrier-free access across the campus, any renovation work shall incorporate the use of lever handles that turn in towards the door on all doors except in the case of:

- a) Existing buildings required by Authorities Having Jurisdiction to maintain hardware for historical or heritage reasons.
- b) Utility rooms where accessible hardware cannot be installed.
- c) All stairwell exits.

All barrier-free access doors incorporating the use of a power door operator shall follow the University's Facility Accessibility Design Standard.

All hardware shall have a manufacturer warranty of minimum one year.

1. Keying

All cylinders for locksets shall be supplied and installed by the University of Toronto Lock Shop.

Key switch approved manufacturers:

- a) Rutherford
- b) Controls
- c) Camden
- d) IEI

2. Closers

Closers shall be surface mounted overhead type. All closers shall be field serviceable.

Approved manufacturers:

- a) LCN (4041 for exterior and stairwell doors and 1461 for other doors)
 - b) Sargent
 - c) Norton
-

3. Door operators

Operators shall be Horton 4000 series or Rhinotek 4000 for all doors. The only exception is a single stall barrier-free washroom which shall be a Horton 7000 series or Rhinotek 7000 door operators. Refer to Appendix A, drawing ADO-1, ADO-2, and ADO-3 for typical wiring schematics for automatic door operator.

Approved manufacturers:

- a) Horton
- b) Rhinotek

4. Locksets

All locksets shall be constructed to ANSI standard mortise lockset.

Approved manufacturers:

Mortise locksets:

- a) Schlage
- b) Sargent
- c) Corbin

Mortise locksets electric:

- a) Schlage
- b) Sargent

5. Exit devices

All exit devices shall be a flat bar regular style device. If the exit devices on the exterior door is not a part of the university's security systems, then cylinder dogging shall be used on the exit device.

Approved manufacturers:

Exit devices

- a) Von Duprin
- b) Sargent
- c) Corbin

Panic devices, electric latch retraction

- a) Sargent
- b) Von Duprin QEL

6. Hinges

All hinges on oversized doors shall be a continuous hinge.

All hinges for interior doors shall be a full mortise hinge.

All electric transfers through any door shall be concealed wire contact transfer hinge.

Note: pivot hinges are not acceptable.

Approved manufacturers:

Hinges, continuous

- a) Markar
- b) McKinney
- c) Gallery

Hinges, full mortise

- a) McKinney
- b) Hager

7. Electric locking devices

All doors using a card access system and/or barrier-free access shall use electric latch retraction panic device or an electric mortise lockset with request to exit feature.

Electric locking devices shall be powered by 24 volts dc with the exception of standalone battery operated locksets.

Electric strikes shall only be used in the following locations:

- Barrier-free washrooms. Refer to Appendix A, drawing WR-01, 02, 03 and 04.

Approved manufacturers:

- a) Hess
- b) Von Duprin
- c) Folger Adams

8. Door pulls and kick plates

Door pulls with through bolt fixing shall be at or near the same height as push plates so that the pull bolts will be hidden. Hardware shall not require polishing or maintenance. All edges shall be rounded. Kick plates on doors shall be stainless steel for full width of door.

Approved manufacturers:

Flush bolts

- a) Ives
- b) Rixson

Surface bolts

-
- a) Glynn Johnson
 - b) Ives

9. Door seals

Approved manufacturers:

- a) K.N. Crowder
- b) Rixson


10. Standard measurements

The following hardware shall be installed at the recommended heights and identified on the shop drawings:

- Door pulls 900 mm to 1000 mm
- Door bar 900 mm to centre line
- Door lever 1000 mm to centre line
- Exit device bolt 950 mm to centre line

Appendix A

(Drawings commence in the following page)

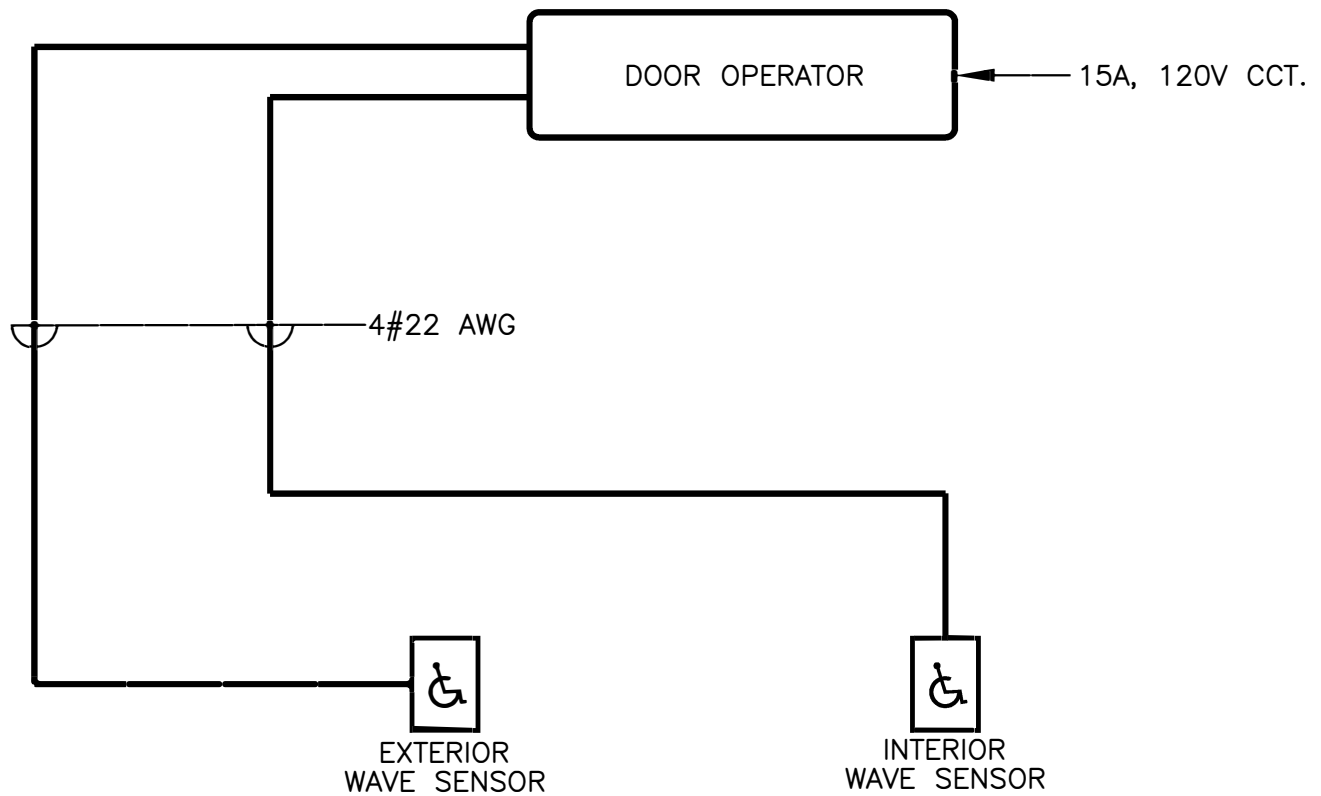

NOTES:

1. DOOR OPERATOR SHALL BE SUPPLIED AND INSTALLED BY GENERAL CONTRACTOR AND WIRED BY ELECTRICAL CONTRACTOR. 120VAC RECEPTACLE TO BE ADDED INSIDE OPERATOR BOX.
2. FINAL LOW VOLTAGE WIRING CONNECTIONS AND COMMISSIONING SHALL BE COMPLETED BY THE MANUFACTURER.
3. USE BX (AC90) FOR POWER WIRING TO THE DOOR OPERATOR ONLY THROUGH HOLLOW METAL DOOR FRAME WHERE ACCESSIBLE.



University Of Toronto
REAL ESTATE OPERATIONS
DESIGN & ENGINEERING

Project:
UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Ti tie:
**TYPICAL WIRING SCHEMATIC FOR
AUTOMATIC DOOR OPERATOR
WITH NON-LATCHABLE DOOR**


Drawn by: GDP

Scale: N.T.S.

Date: JUNE 2023

Drawing No.

ADO-1

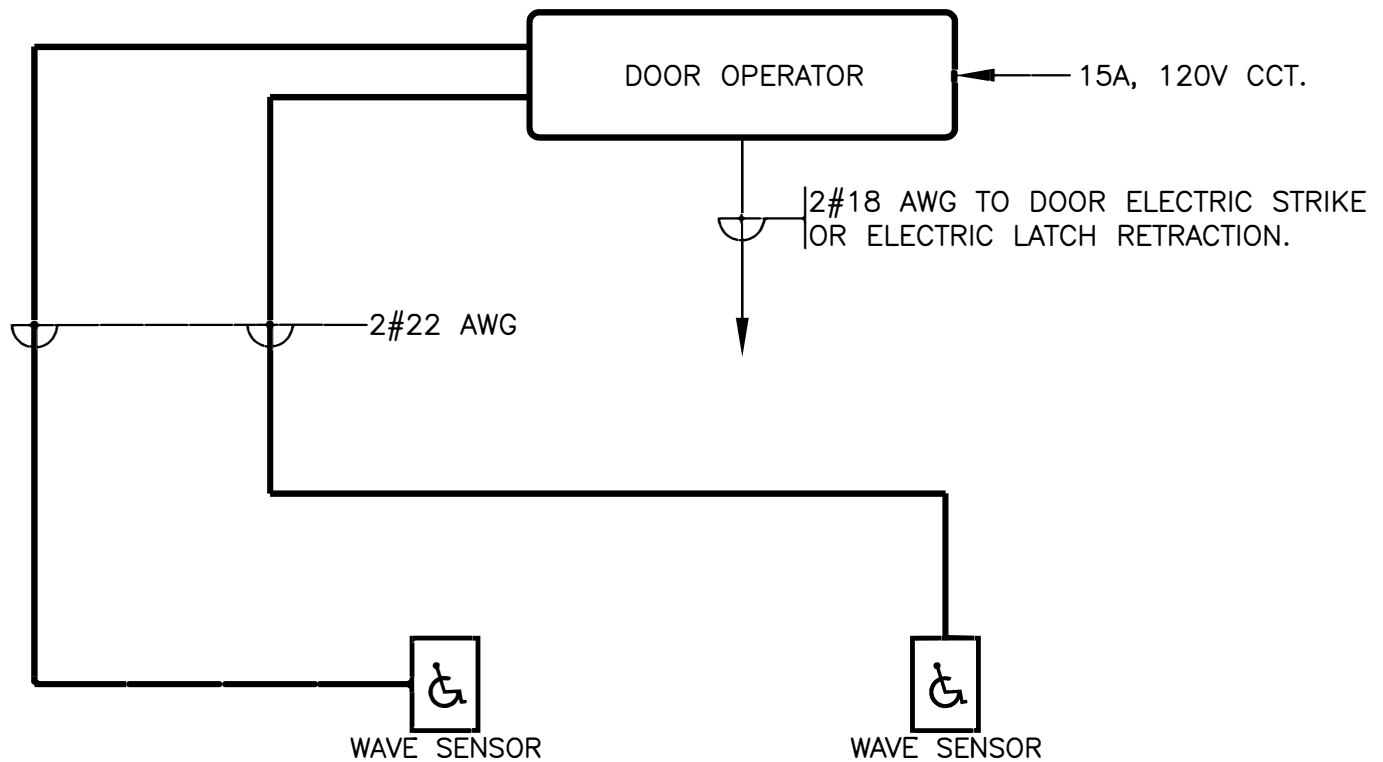

NOTES:

1. DOOR OPERATOR SHALL BE SUPPLIED AND INSTALLED BY GENERAL CONTRACTOR, AND WIRED BY ELECTRICAL CONTRACTOR. 120VAC RECEPTACLE TO BE ADDED INSIDE OPERATOR BOX. ELECTRIC STRIKE SHALL BE SUPPLIED BY GENERAL CONTRACTOR, AND INSTALLED AND WIRED BY ELECTRICAL CONTRACTOR.
2. FINAL LOW VOLTAGE WIRING CONNECTIONS AND COMMISSIONING SHALL BE COMPLETED BY THE MANUFACTURER.
3. USE BX (AC90) FOR POWER WIRING TO THE DOOR OPERATOR ONLY THROUGH HOLLOW METAL DOOR FRAME WHERE ACCESSIBLE.



University Of Toronto
REAL ESTATE OPERATIONS
DESIGN & ENGINEERING

Project:
UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Title:
**TYPICAL WIRING SCHEMATIC FOR
AUTOMATIC DOOR OPERATOR
WITH LATCHABLE DOOR**


Drawn by: GDP

Scale: N.S.

Date: JUNE 2023

Drawing No.

ADO-2

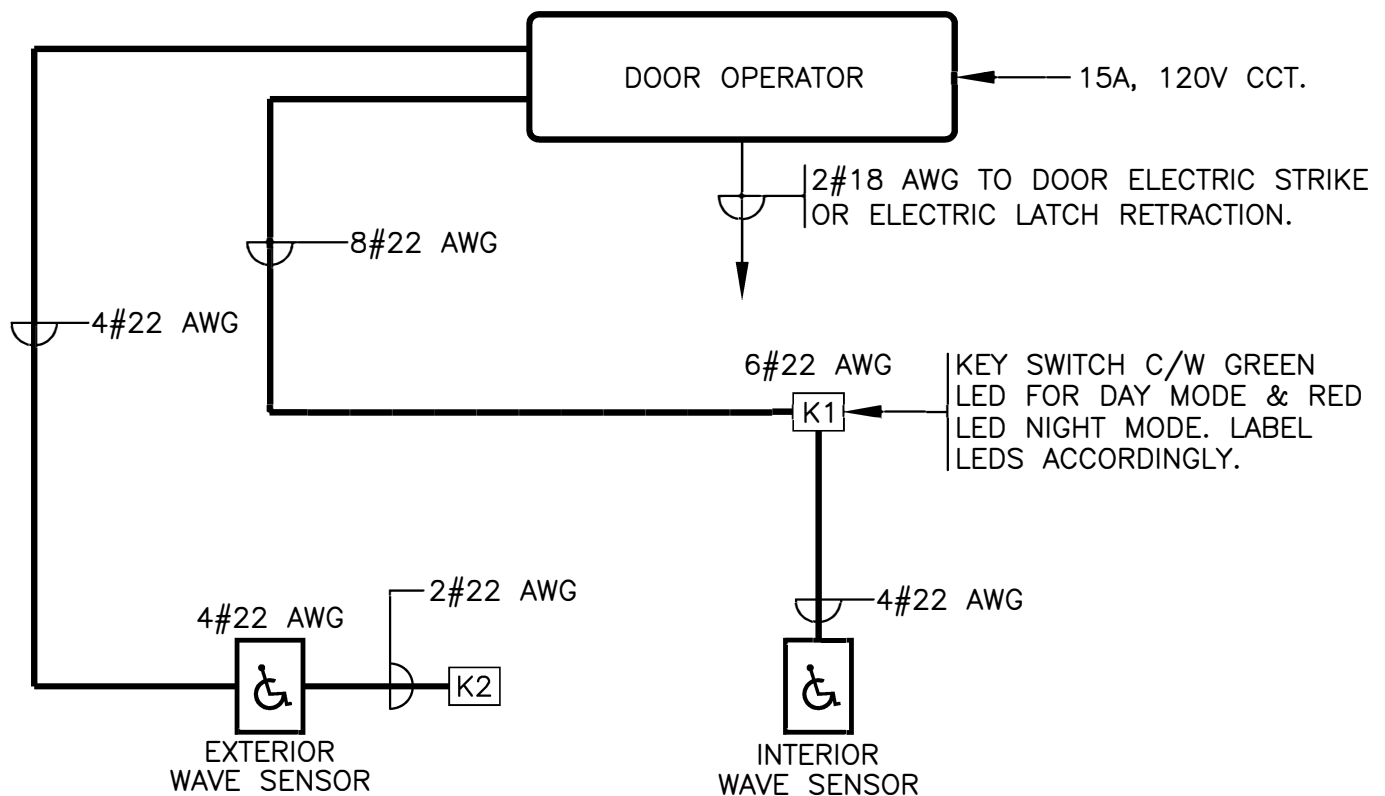

OPERATION:

- K1** INSIDE KEY SWITCH RESTRICTS DOOR OPERATOR FROM EXTERIOR AFTER HOURS. INTERIOR WAVE SENSOR OPENS DOOR IN DAY OR NIGHT MODE. KEY SWITCH SHALL BE COMPLETE WITH MAINTAINED CONTACTS LED. OUTLET BOX TO ALLOW THE KEY FACE PLATE TO BE MATCHED TO THE BOX MOUNTING HOLES AND TAMPER PROOF SCREWS FOR MOUNTING THE KEY FACE PLATE. KEY SWITCH TO MATCH MASTER BUILDING KEY.
- K2** EXTERIOR KEY SWITCH OPENS THE DOOR AFTER HOURS. EXTERIOR WAVE SENSOR OPENS DOOR IN DAY MODE ONLY. KEY SWITCH SHALL BE COMPLETE WITH MOMENTARY CONTACT. OUTLET BOX TO ALLOW THE KEY FACE PLATE TO BE MATCHED TO THE BOX MOUNTING HOLES AND TAMPER PROOF SCREWS FOR MOUNTING THE KEY FACE PLATE. KEY SWITCH TO MATCH BUILDING MASTER KEY.

NOTES:

- DOOR OPERATOR SHALL BE SUPPLIED AND INSTALLED BY GENERAL CONTRACTOR, AND WIRED BY ELECTRICAL CONTRACTOR. 120VAC RECEPTACLE TO BE ADDED INSIDE OPERATOR BOX. KEY CYLINDERS BY U. of T. LOCKSHOP AND ELECTRIC STRIKE BY GENERAL TRADE. ELECTRIC STRIKE INSTALLED AND WIRED BY ELECTRICAL CONTRACTOR.
- FINAL LOW VOLTAGE WIRING CONNECTIONS AND COMMISSIONING SHALL BE COMPLETED BY THE MANUFACTURER.
- USE BX (AC90) FOR POWER WIRING TO THE DOOR OPERATOR ONLY THROUGH HOLLOW METAL DOOR FRAME WHERE ACCESSIBLE.



University Of Toronto
REAL ESTATE OPERATIONS
DESIGN & ENGINEERING

Project:
UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Title:
**TYPICAL WIRING SCHEMATIC FOR
AUTOMATIC DOOR OPERATOR
WITH LOCKABLE DOOR**

Drawn by: GDP


Scale: N.T.S.

Date: JUNE 2023


Drawing No.

ADO-3



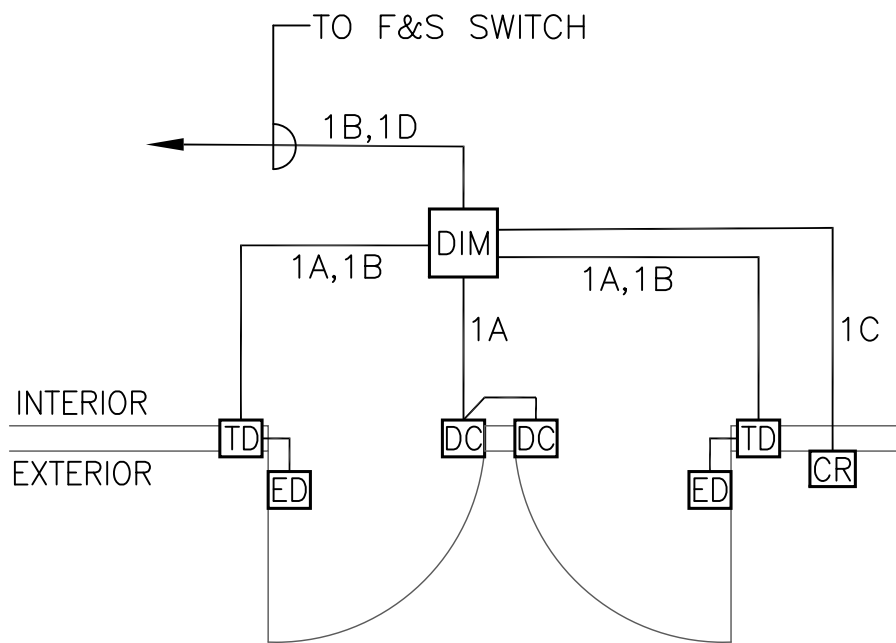


PLAN VIEW

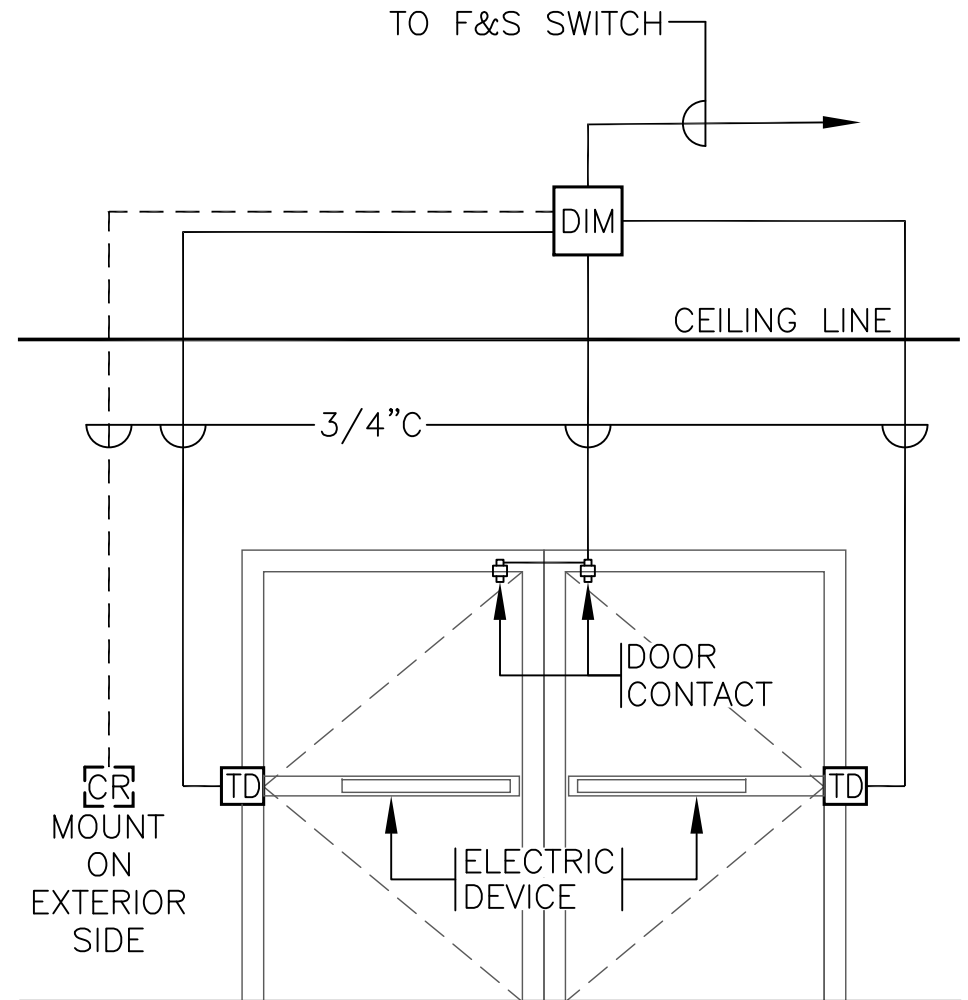


ELEVATION
(INTERIOR)




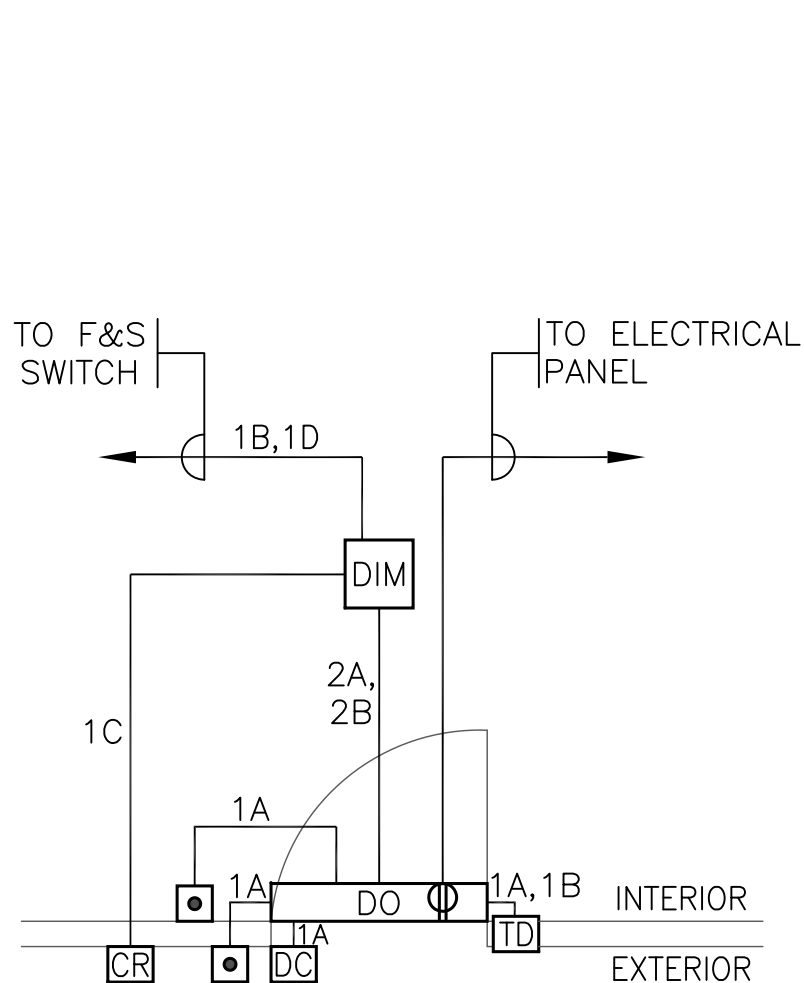


PLAN VIEW

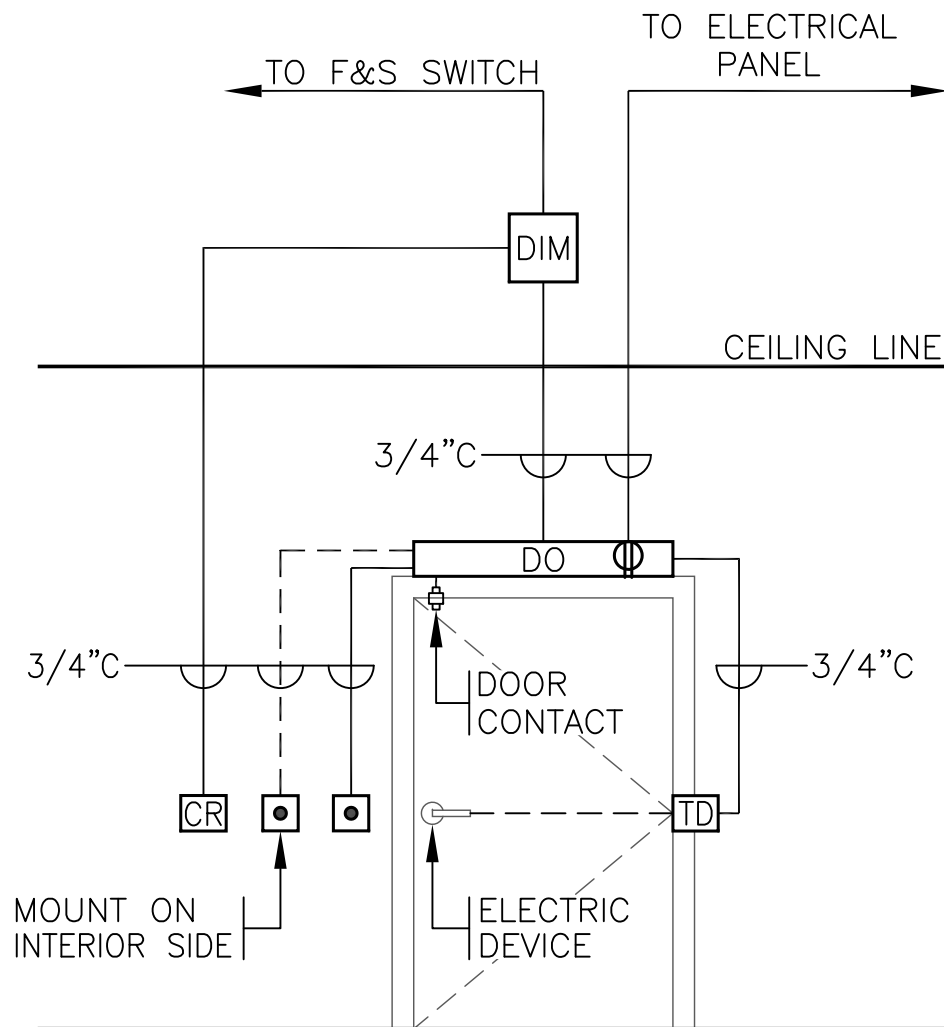

ELEVATION
(EXTERIOR)

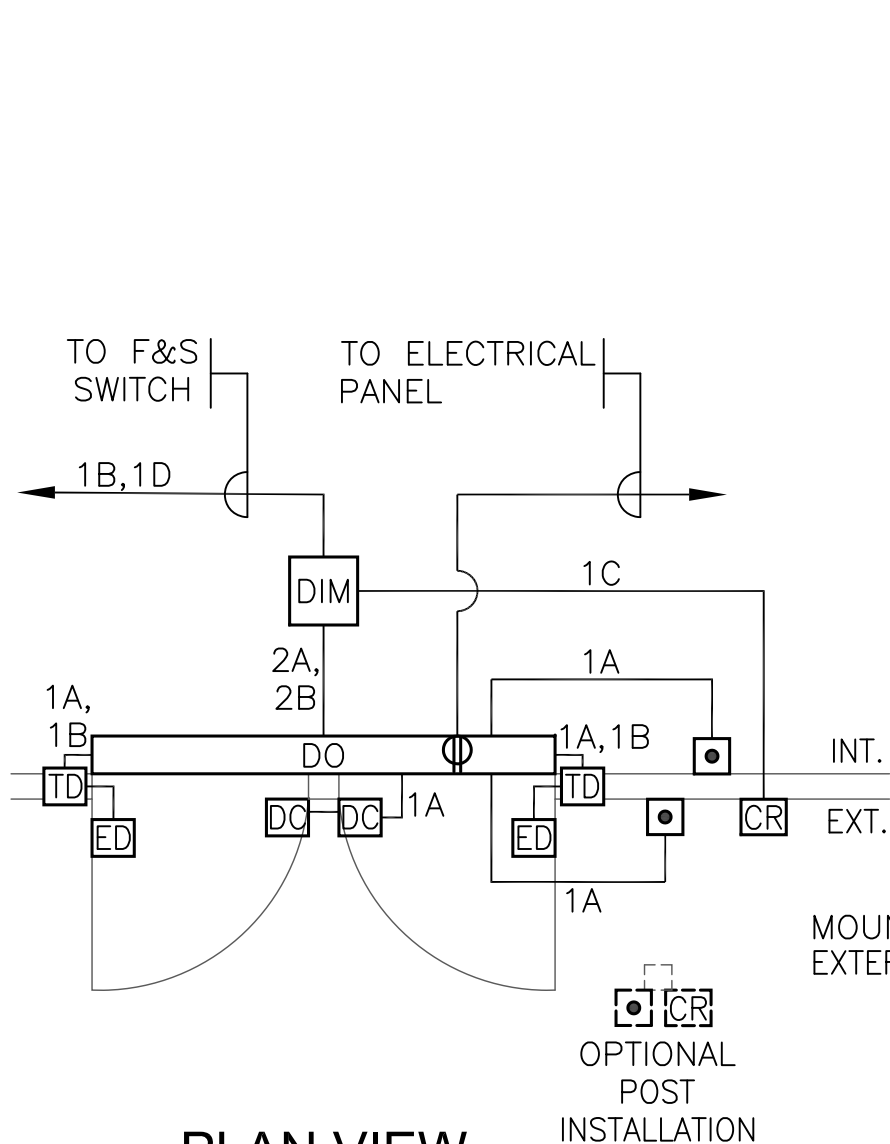

PLAN VIEW

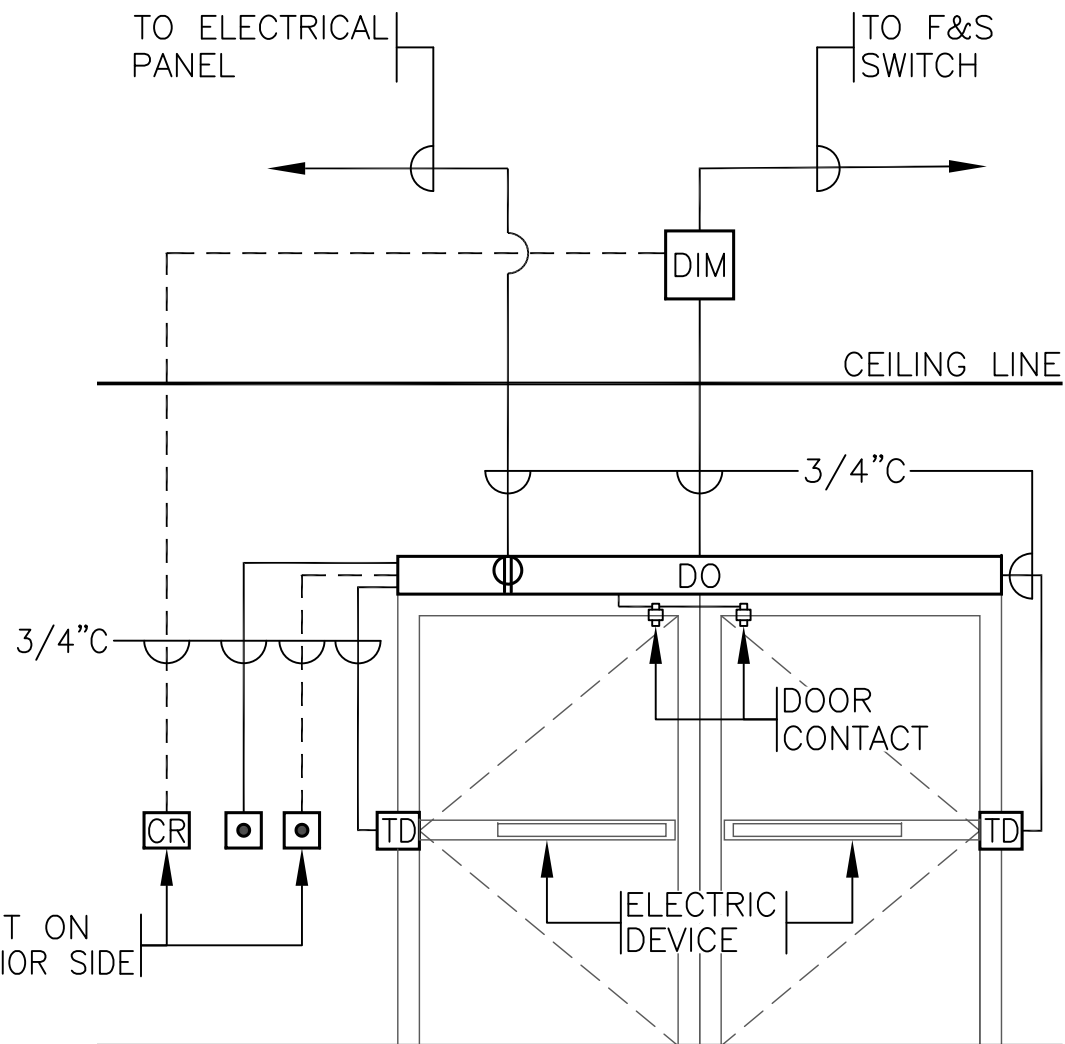

ELEVATION
(INTERIOR)


WIRE & CABLE LEGEND

CABLE	DESCRIPTION	BELDEN #	APPLICATION
A	2PR, 22AWG, STRANDED, SHEILDED, TWISTED PR.	8723	DOOR CONTACT/REX/LOCK STATUS
B	1PR, 18AWG, STRANDED, SHIELDED, TWISTED PR.	9740	ELECTRIC LOCK/AUDIBLE ALARM
C	3PR, 22AWG, STRANDED, SHEILDED, TWISTED PR.	8777	CARD READER
D	CAT. 6 CABLE		

FIELD DEVICE LEGEND

SYMBOL	DESCRIPTION
	CARD READER
	DOOR CONTACT
	ELECTRIC DEVICE
	ELECTRIC TRANSFER DEVICE
	DOOR OPERATOR
	DOOR INTERFACE MODULE
	DOOR ACTIVATION DEVICE

WIRE TAGGING

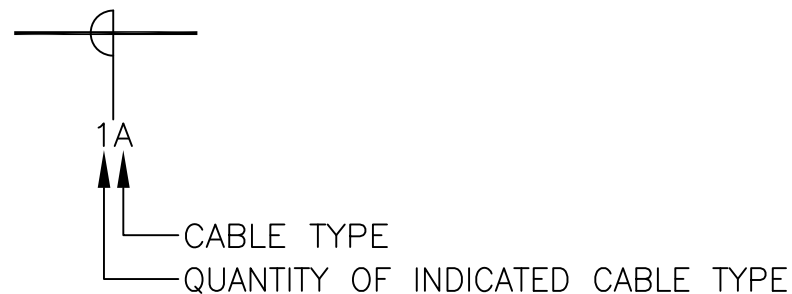

University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Title: ENTERPRISE BUILDINGS INTEGRATOR
FAULT TOLERANT SERIES INTERIOR DOOR WIRING
LEGENDS & WIRE TAGGING DIAGRAM

Drawn by: GDP

Scale: N.T.S.

Date: JUNE 2023

Project No.

Drawing No.
FT-INT-05A

NOTES: (INTERIOR DOOR)

1. FOR EXACT HEIGHTS, REFER TO AODA SPECIFICATIONS.
2. LOW VOLTAGE WIRING SHALL BE COPPER CONDUCTORS.
3. MINIMUM CONDUIT SIZE TO BE 3/4".

SEQUENCE OF OPERATION (INTERIOR DOOR WITH CARD READER):

FOR LOCKED DOORS:

- CARD READER UNLOCKS DOOR.
- ONCE CLOSED, DOOR LOCKS.
- IF DOOR IS LEFT AJAR, BUZZER WILL SOUND.



University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Title: ENTERPRISE BUILDINGS INTEGRATOR
FAULT TOLERANT SERIES INTERIOR DOOR WIRING
NOTES & SEQUENCE OF OPERATION

Drawn by: GDP


Scale: N.T.S.

Date: JUNE 2023


Project No.

Drawing No.


FT-INT-05B

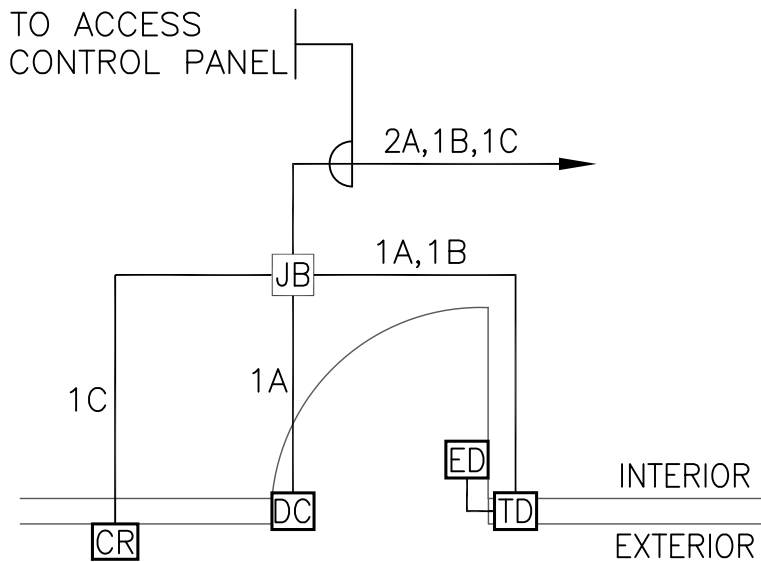


PLAN VIEW

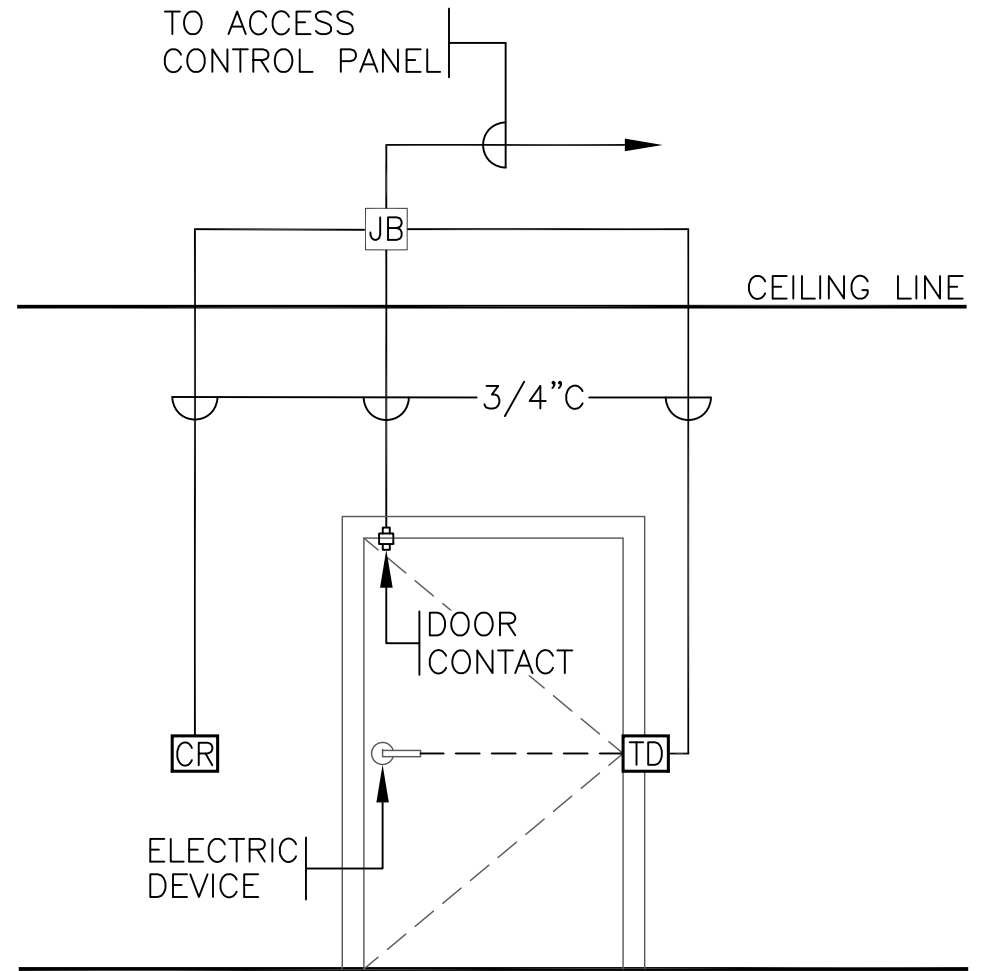

ELEVATION
(EXTERIOR)

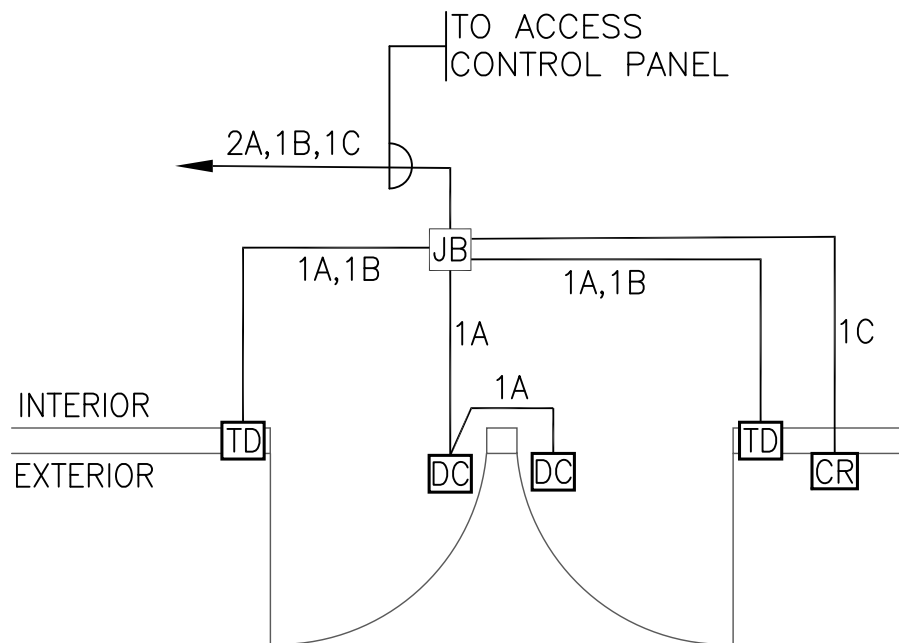

PLAN VIEW

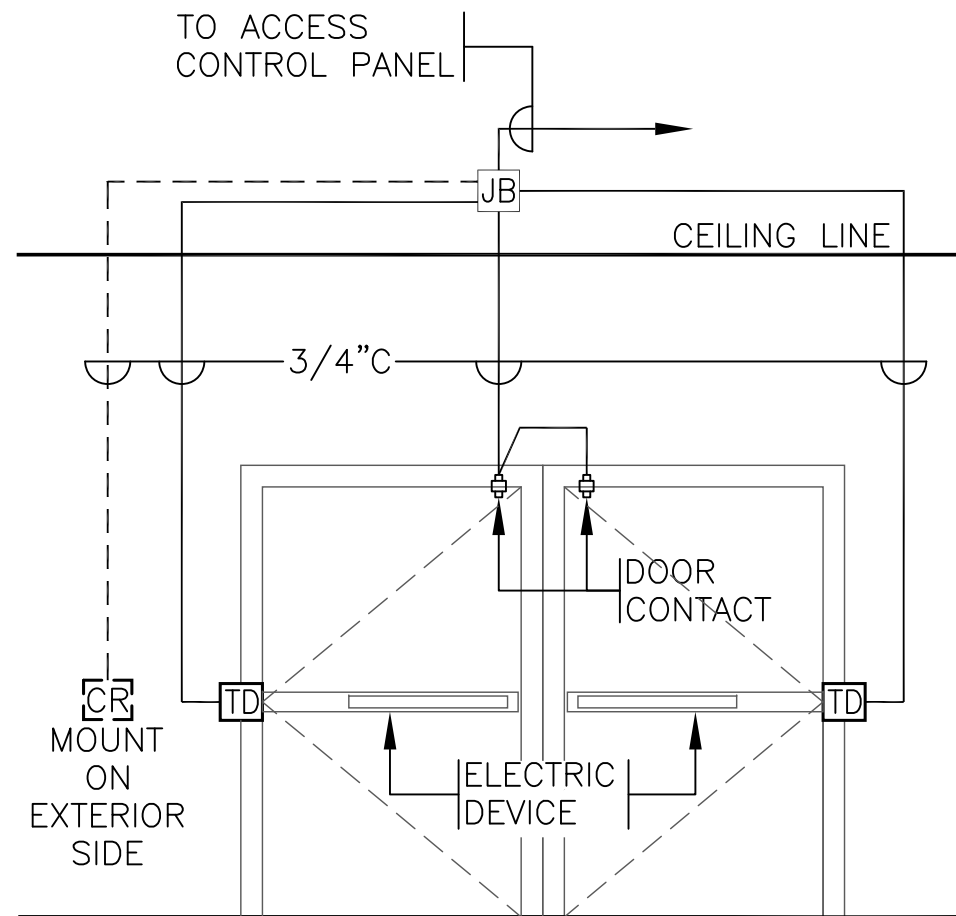

ELEVATION
(INTERIOR)

WIRE & CABLE LEGEND

CABLE	DESCRIPTION	BELDEN #	APPLICATION
A	2PR, 22AWG, STRANDED, SHEILDED, TWISTED PR.	8723	DOOR CONTACT/REX/LOCK STATUS
B	1PR, 18AWG, STRANDED, TWISTED PR.	9740	ELECTRIC LOCK/AUDIBLE ALARM
C	3PR, 22AWG, STRANDED, SHEILDED, TWISTED PR.	8777	CARD READER, RS485 COMMUNICATIONS
D	CAT. 6		

FIELD DEVICE LEGEND

SYM.	DESCRIPTION	SYM.	DESCRIPTION
CR	CARD READER	RX	REQUEST TO EXIT
DC	DOOR CONTACT	TD	ELECTRIC TRANSFER DEVICE
EL	ELECTRIC LOCK	JB	JUNCTION BOX (ACCESSIBLE FOR MAINTENANCE)


NOTES: (INTERIOR DOOR)

1. FOR EXACT HEIGHTS, REFER TO AODA SPECIFICATIONS.
2. LOW VOLTAGE WIRING SHALL BE COPPER CONDUCTORS.
3. MINIMUM CONDUIT SIZE TO BE 3/4".


SEQUENCE OF OPERATION (INTERIOR DOOR WITH CARD READER):

FOR LOCKED DOORS:

- CARD READER UNLOCKS DOOR.
- ONCE CLOSED, DOOR LOCKS.
- IF DOOR IS LEFT AJAR, BUZZER WILL SOUND.

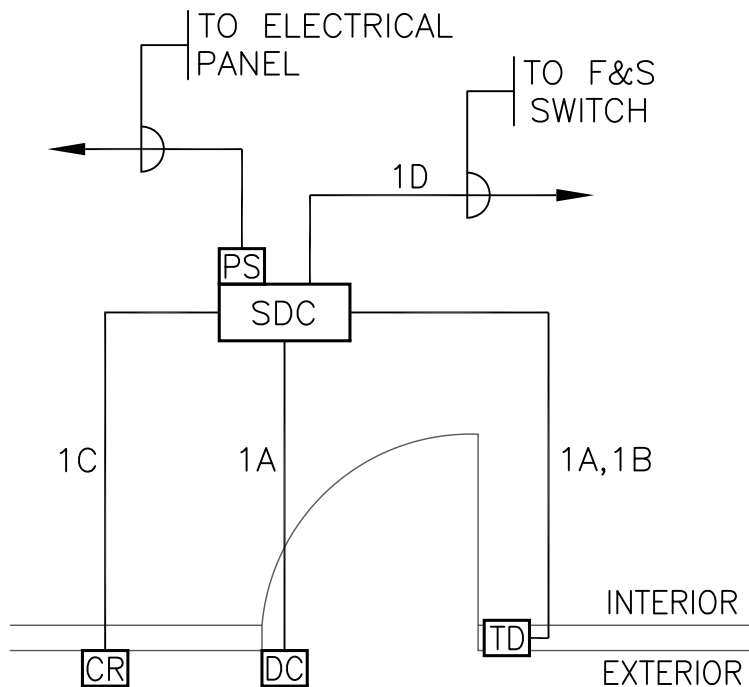

PLAN VIEW

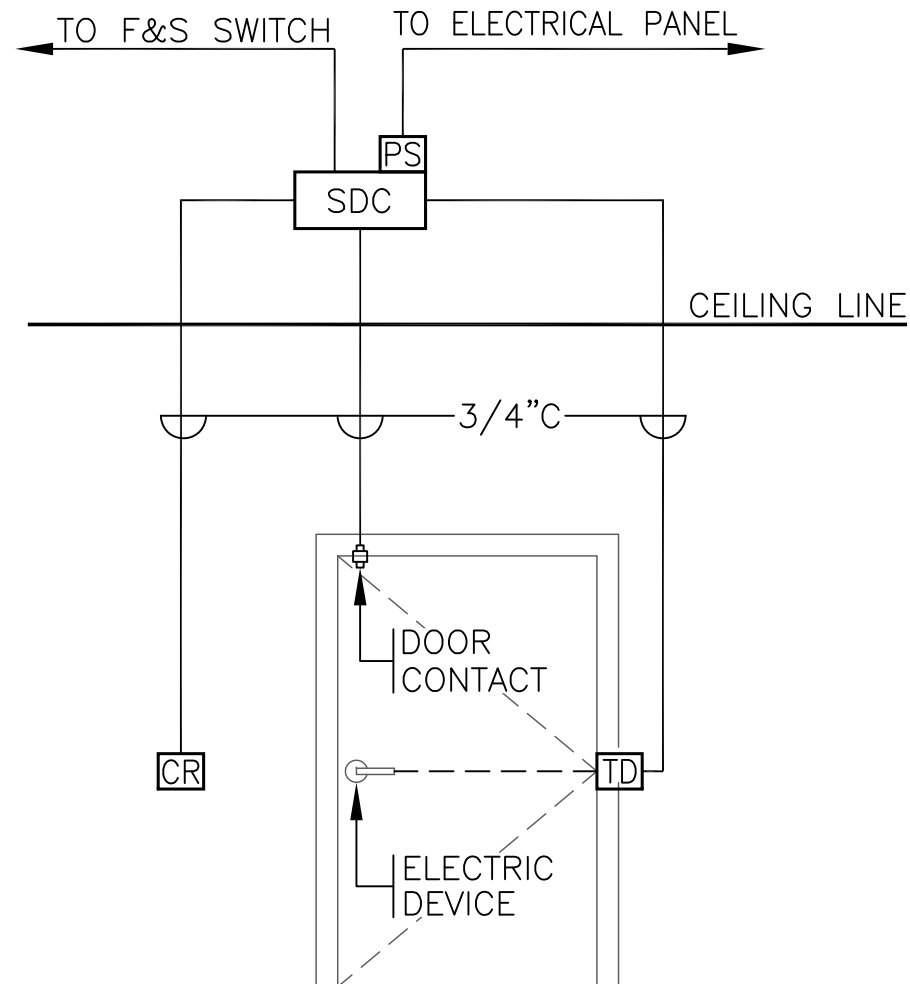

ELEVATION
(EXTERIOR)




University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS
Title: TYPICAL SALTO WIRING SCHEMATIC FOR
SINGLE DOOR W/ CARD READER &
EXIT DEVICE

Drawn by: GDP
Scale: N.T.S.
Date: JUNE 2023

Project No.
Drawing No.



S-INT-01



Drawn by:	GDP
Scale:	N.T.S.
Date:	JUNE 2023

Drawing No.

S-INT-02

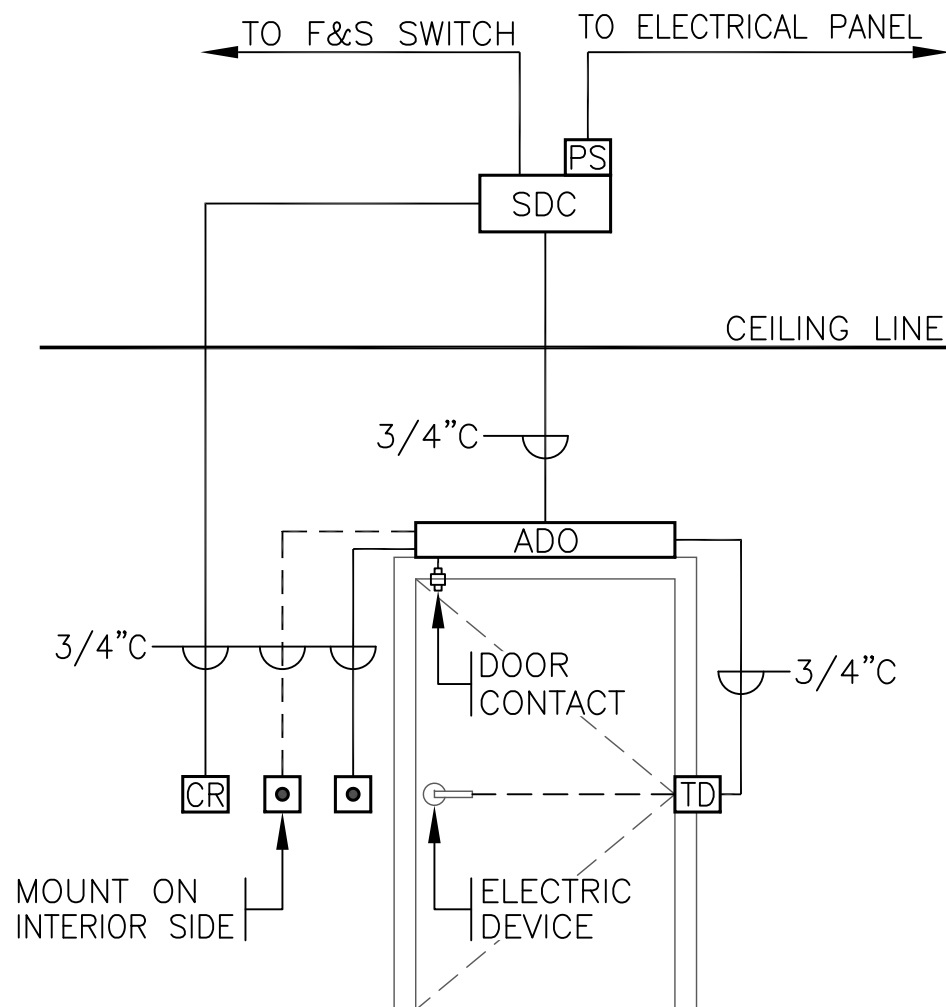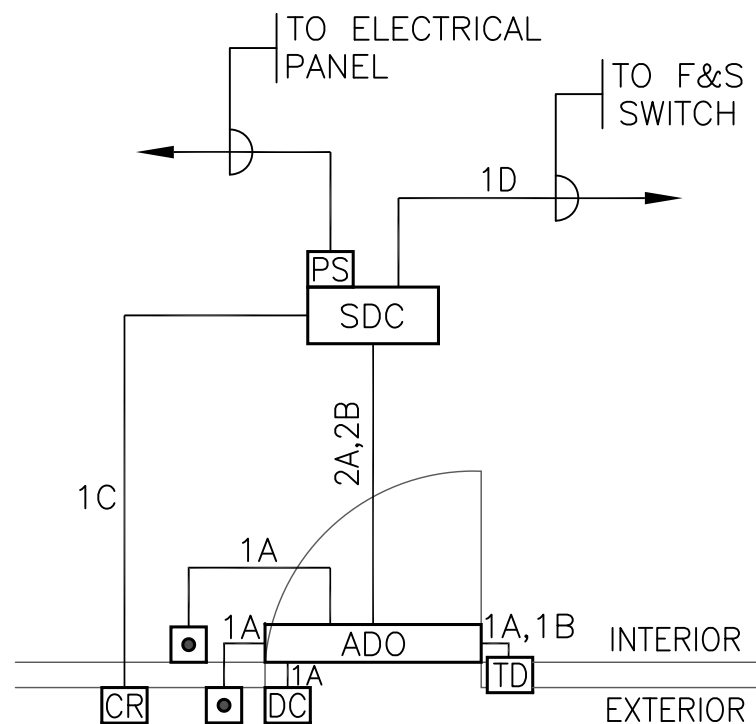

WIRE & CABLE LEGEND

CABLE	DESCRIPTION	BELDEN #	APPLICATION
A	2PR, 22AWG, STRANDED, SHEILDED, TWISTED PR.	8723	DOOR CONTACT/REX/LOCK STATUS
B	1PR, 18AWG, STRANDED, TWISTED PR.	9740	ELECTRIC LOCK/AUDIBLE ALARM
C	3PR, 22AWG, STRANDED, SHEILDED, TWISTED PR.	8777	CARD READER
D	CAT. 6 CABLE		

FIELD DEVICE LEGEND


SYMBOL	DESCRIPTION
	CARD READER
	DOOR CONTACT
	ELECTRIC TRANSFER DEVICE
	DOOR ACTIVATION DEVICE
	DOOR OPERATOR
	SALTO DOOR CONTROLLER
	POWER SUPPLY

SEQUENCE OF OPERATION (INTERIOR DOOR WITH CARD READER):

FOR LOCKED DOORS:

- CARD READER UNLOCKS DOOR.
- ONCE CLOSED, DOOR LOCKS.
- IF DOOR IS LEFT AJAR, BUZZER WILL SOUND.

WIRE TAGGING

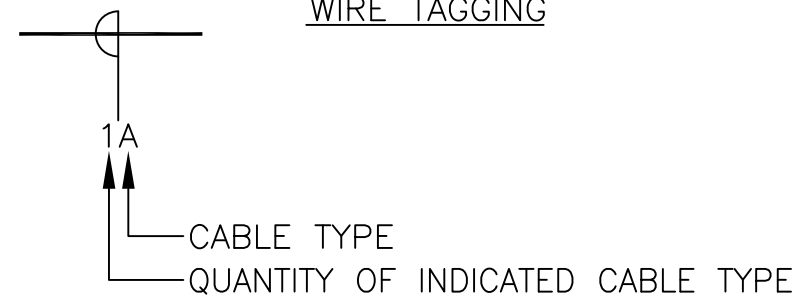

University of Toronto
UPDC
DESIGN & ENGINEERING

Project: **UNIVERSITY of TORONTO SECURITY DOOR DETAILS**
 Title: **TYPICAL SALTO WIRING SCHEMATIC
LEGENDS, SEQUENCE OF OPERATION &
WIRE TAGGING DIAGRAM**

Drawn by: GDP
 Scale: N.T.S.
 Date: JUNE 2023

Project No.

Drawing No.

S-INT-05

NOTES:

1. DOOR HARDWARE SUPPLIED AND INSTALLED BY PROJECT.
2. SECURITY ACCESS CONTROL COMPONENTS, CARD READERS, DOOR CONTACTS, AND GLASS BREAK TO BE PROVIDED BY PROJECT, AS PER THIS STANDARD.
3. ALL FIELD DEVICES MOUNTED AND TERMINATED BY ELECTRICAL CONTRACTOR.
4. PRIOR TO INSTALLATION, COORDINATE LOCATION OF FIELD DEVICES AND SECURITY ACCESS CONTROLLER WITH THE UNIVERSITY.
5. PROVIDE NEW SECURITY SYSTEM AS SHOWN ON THIS DRAWING. ALL THE SECURITY SYSTEM DEVICES SUCH AS CARD READERS, GLASS BREAK AND DOOR CONTACTS SHALL BE INSTALLED AND ROUGH-IN BY ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR WILL PROVIDE ALL THE NECESSARY CONDUITS AND WIRING AS REQUIRED TO MAKE THE SECURITY SYSTEM FULLY FUNCTIONAL. THE SECURITY SYSTEM SHALL BE COMMISSIONED BY F&S. COORDINATE WITH F&S ON SITE.



University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS
Title: TYPICAL SALTO WIRING SCHEMATIC
NOTES

Drawn by: GDP
Scale: N.T.S.
Date: JUNE 2023

Project No.
Drawing No.
S-INT-06

WORK RESPONSIBILITY

BY ELECTRICAL CONTRACTOR:

1. PROVIDE ALL WIRING, CONDUIT & JUNCTION BOXES.
2. PROVIDE ALL WIRING AS NOTED ON THIS SCHEMATIC. WIRING SHALL BE SOLID COPPER CONDUCTORS, RISER RATED & INSTALLED IN CONDUIT.

BY UoT CONTRACTOR:

1. PROVIDE ALL CARD READERS, DOOR CONTROLLERS, DOOR CONTACTS, RX/LX DEVICES.
2. FINAL CONNECTIONS, PROGRAMMING & COMMISSIONING OF DOOR CONTROL SYSTEM.

BY GENERAL CONTRACTOR:

1. PROVIDE TRANSFER HINGE. REFER TO ARCHITECTURAL DRAWINGS & SPECIFICATION FOR REQUIREMENTS.



University of Toronto
UPDC
DESIGN & ENGINEERING


Project:
UNIVERSITY of TORONTO SECURITY DOOR DETAILS
Title:
**TYPICAL SALTO WIRING SCHEMATIC
WORK RESPONSIBILITY**

Drawn by: GDP
Scale: N.T.S.
Date: JUNE 2023

Project No.

Drawing No.

S-INT-07

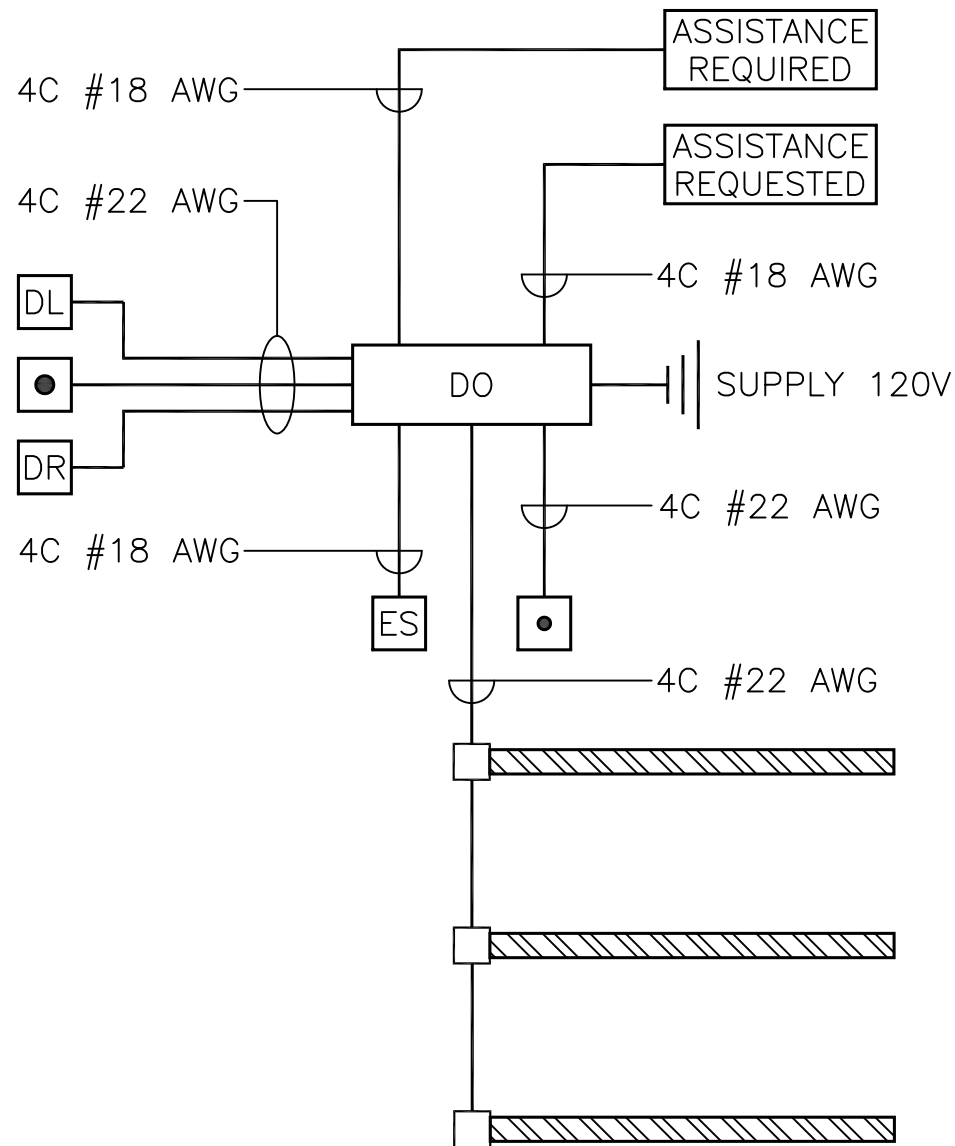

FIELD DEVICE LEGEND

SYMBOL	DESCRIPTION
	DOOR OPENER
	DOOR ACTIVATION DEVICE
	DOOR LOCK DEVICE (PUSH TO LOCK PLATE SWITCH)
	DOOR RESET BUTTON. PROVIDE LAMACOID PLATE, 1/8" HIGH BLACK LETTERS ON WHITE BACKGROUND TO READ "PRESS TO RESET".
	ELECTRIC STRIKE
	"ASSISTANCE REQUESTED" SIGN
	"ASSISTANCE REQUIRED" SIGN
	EMERGENCY CALL STRIP. "EMERGENCY ALARM – PRESS FOR ASSISTANCE". BLACK LETTERING ON YELLOW BACKGROUND. PROVIDE LAMACOID PLATE, 1/4" HIGH RED LETTERS ON WHITE BACKGROUND TO READ, "EMERGENCY PUSH STRIP – USE ONLY IN AN EMERGENCY." MOUNT LABEL ABOVE EACH PUSH STRIP.



University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Title: TYPICAL FIELD DEVICE LEGEND FOR
LOCKABLE & ALARMED WASHROOM DOOR

Drawn by: GDP

Scale: N/A

Date: JUNE 2023

Project No.

Drawing No.

WR-02

SEQUENCE OF OPERATION: ACCESSIBLE WASHROOM

- | | |
|--|--|
| <ul style="list-style-type: none">• DOOR ACTIVATION DEVICE OPENS DOOR.• DOOR LOCK DEVICE DEACTIVATES EXTERIOR DOOR ACTIVATION DEVICE, LOCKS THE DOOR & ACTIVATES THE IN USE SIGN.• INTERIOR DOOR ACTIVATION DEVICE UNLOCKS AND OPENS THE DOOR & DEACTIVATES THE IN USE SIGN. | <ul style="list-style-type: none">• EMERGENCY CALL STRIPS ACTIVATE THE ASSISTANCE REQUIRED SIGN, THE AUDIBLE BUZZER & UNLOCKS THE DOOR.• DOOR RESET BUTTON RETURNS THE SYSTEM TO NORMAL MODE. |
|--|--|

NOTES: (ACCESSIBLE WASHROOM)

1. FOR EXACT HEIGHTS, REFER TO ARCHITECTURAL DRAWINGS.
2. LOW VOLTAGE WIRING SHALL BE COPPER CONDUCTORS.
3. ALL LOW VOLTAGE WIRING SHALL BE STRANDED & SHIELDED INSTALLED IN CONDUIT OR PLENUM RATED IN HOLLOW METAL DOOR FRAME WHERE ACCESSIBLE.
4. RUN WIRES IN TO HEADER OF AUTOMATIC DOOR OPERATOR OPPOSITE HINGE SIDE ABOVE DOOR JAMB TO ALLOW FOR ORGANIZED LOW VOLTAGE WIRING DUE TO LOCATION OF RELAY.
5. MINIMUM CONDUIT SIZE TO BE 3/4".




University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS
Title: TYPICAL SEQUENCE OF OPERATION & NOTES
FOR LOCKABLE & ALARMED WASHROOM DOOR

Drawn by: GDP
Scale: N/A
Date: JUNE 2023

Project No.
Drawing No.

WR-03

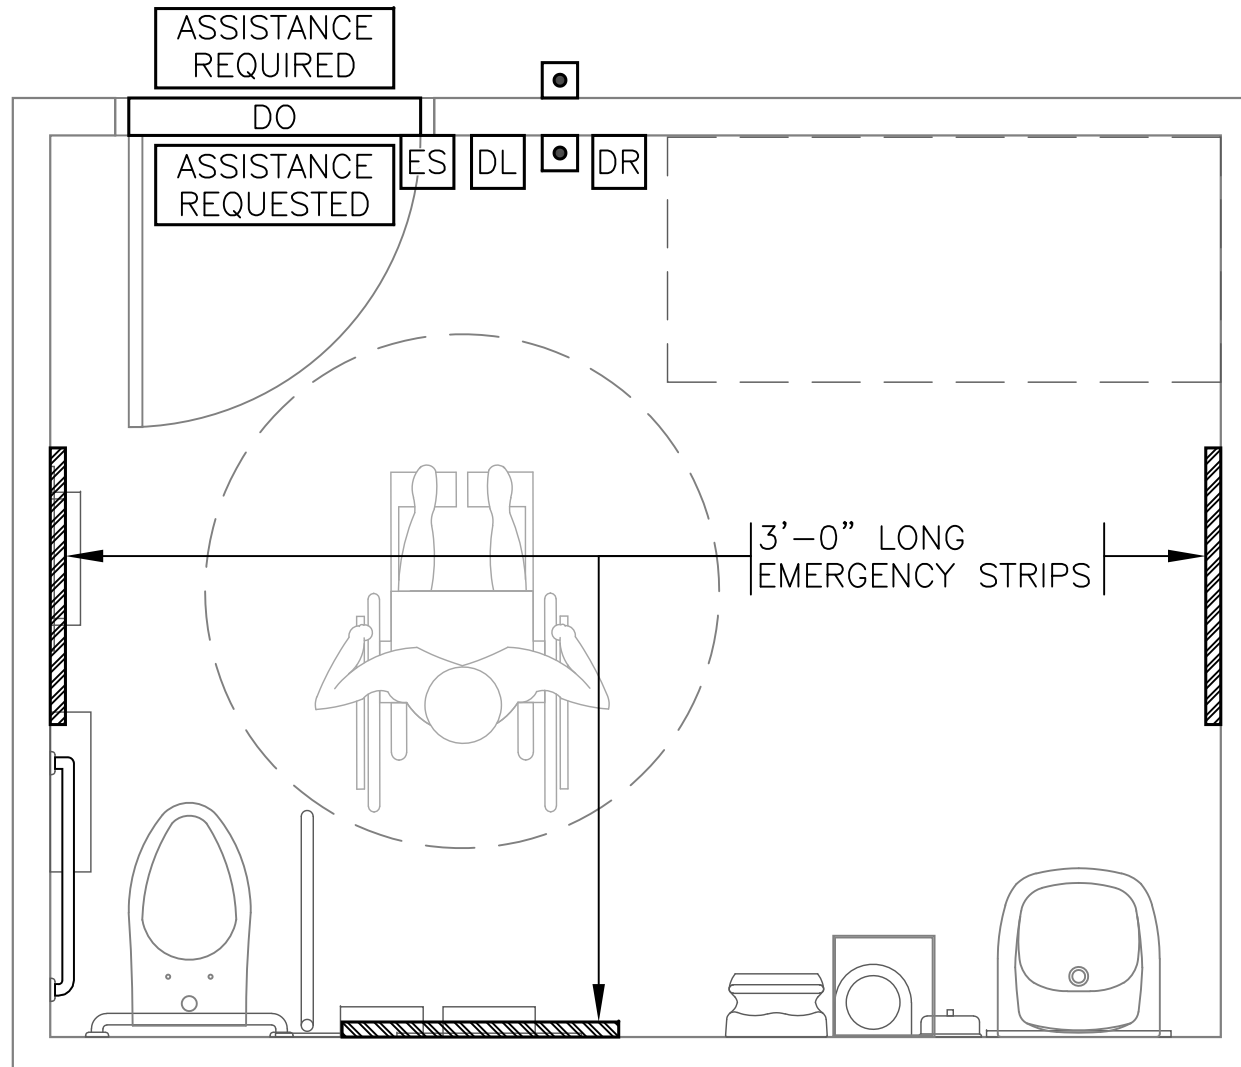

University of Toronto
UPDC
DESIGN & ENGINEERING

Project: UNIVERSITY of TORONTO SECURITY DOOR DETAILS

Title: TYPICAL WASHROOM ELECTRICAL LAYOUT FOR LOCKABLE & ALARMED WASHROOM DOOR

Drawn by: GDP

Scale: N/A

Date: JUNE 2023

Project No.

Drawing No.

WR-04